## **AM-FD** Activation Mechanism Data Sheet





# Table of Contents

Description
Design
Material Composition
Product Parts
Manually Operated Activation Mechanism
Dimensions
Ordering Code
Technical Parameters
Transport & Storage
Supplement
Related Products



Good to know

Current information on all products is available on  $\mathscr{O}$  www.design.systemair.com



## Description

The activation mechanism for FD fire dampers is a crucial part of the damper. Its purpose is to drive the fire damper's blade between the open and closed positions. In case of emergency, AM-FD will close the damper blade and remain closed to fulfill classification parameters of the fire damper. Activation mechanism types for FD dampers are interchangeable with some degree of compatibility. The AM-FD activation mechanism is suitable for FDR-3G, FDS-3G, FDS-EI90S and FDS-EI120S fire dampers.

### Manually Operated Activation Mechanism

This mechanism can only be opened manually. In case of fire, the fire damper is closed automatically. Depending on the version, the mechanism closes either after melting of the thermal fuse or by means of remote activation through an electromagnet in the impulse connection. After the closing of the damper blade, it is mechanically locked in the closed position. The actuating mechanism is activated when the temperature of the air in the duct reaches 74°C and the damper closes within 10 seconds after melting of the fuse. Its compatibility code starts with a letter.

### Actuator Operated Activation Mechanism

This mechanism is fitted with a spring return actuator and can be opened by supplying power or manually with a supplied crank. Actuator controlled mechanism is standardly equipped with an electro-thermal fuse. Upon request, it can be supplied with different communication and supply units. The mechanism closes the damper after the command from the building management system, or after breaching of the electro-thermal fuse. The fuse is breached after reaching or exceeding the ambient temperature of 72°C and its spring closes the damper blade within 20 seconds. Its compatibility code starts with a number.

### Highlights

- · Can be used as an inspection opening
- Manual mechanism provided with cable
- Manual mechanism with IP 44 rating
- · Switching between different types of actuators and communication units

## **Product Types**

### Manually Operated Activation Mechanism

• H0

Activation mechanism with a cover, manual crank and with a spring return release mechanism activated by a fusible thermal link set to 74°C (100°C upon request).

• H2

Activation mechanism H0 + open and closed indication with AC 230 V or AC/DC 24 V contact switches.

### • H5-2

Activation mechanism H0 + an AC/DC 24 V electromagnetic release mechanism in the impulse connection (release takes place when the electromagnet is activated) + open and closed indication with AC 230 V or AC/DC 24 V contact switches.

• H6-2

Activation mechanism H0 + an AC 230 V electromagnetic release mechanism in the impulse connection (release takes place when the electromagnet is activated) + open and closed indication with AC 230 V or AC/DC 24 V contact switches.

## Actuator Operated Activation Mechanism

#### • B230T or G230T

Activation mechanism with a Belimo (B) or Gruner (G) spring return actuator (AC 230 V) with an electro-thermal fuse 72°C and auxiliary switches.

• B24T or G24T

Activation mechanism with a Belimo (B) or Gruner (G) spring return actuator (AC/DC 24 V) with an electrothermal fuse 72°C and auxiliary switches.

• BSTO or GSTO

Activation mechanism with a Belimo (B) or Gruner (G) spring return actuator (AC/DC 24 V) with an electrothermal fuse 72°C and auxiliary switches, with a Belimo BKN230-24 supply and communication unit or Gruner fs-UFC24-2 supply and communication unit (other communication units upon request).

• B24T-W or G24T-W

Activation mechanism with a Belimo (B) or Gruner (G) spring return actuator (AC/DC 24 V) with an electrothermal fuse 72°C and auxiliary switches, with provided cable connectors for the supply and communication unit (communication unit not part of the mechanism).

	Ту	pe of Activation Mechanism (Code)													
					anual erate				tuato erate						
Part of Activation Mechanism	Part Type	Current Type	Voltage (V)	ЮН	H2	H5-2	H6-2	B230T	B24T	BST0	B24T-W	G230T	G24T	GSTO	G24T-W
Indication Open/Closed	Microswitch	AC, AC/DC	230, 24		•	•	•								
Electromagnet	Impulse	AC/DC	24			•									
Electromagnet	Connecion	AC	230				•								
	230-T	AC	230					•							
Belimo BFL or BFN or BF Actuator	24-T	AC/DC	24						•						
	24-T-ST	AC/DC	24							•	•				
Crupper 2.40 or 2.00 Actuator	TA 230	AC	230									•			
Gruner 340 or 360 Actuator	TA 24	AC/DC	24										•	•	•

Tab. 1: Composition of the activation mechanisms according to the  $\mathscr{P}$ Ordering Code

#### Legend

DC	Direct current
AC	Alternating current
230	Actuator 230 V
24	Actuator 24 V

## Design

## **Material Composition**

The product contains galvanized sheet metal, fireproof carbon fiberglass and ethylene - propylene rubber. These are processed in accordance with local regulations. The product contains no hazardous substances, except for the solder in the thermofuse, which contains a milligram of lead.

## **Product Parts**

### Manually Operated Activation Mechanism

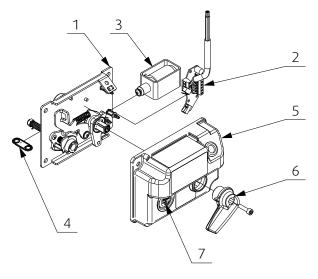



Fig. 1: Components of a manually operated activation mechanism – H0; H2; H5-2; H6-2

1 ~ ~	~	~	А	
Leg	e	п	u	

1	Mechanism base with internals
2	Circuit board with end position switches (included only in H2; H5-2; H6-2)
3	Electromagnet in impulse connection (included only in H5-2; H6-2)
4	Thermal link (standard 74°C)
5	Manual mechanism plastic cover
6	Red lever for opening damper blade
7	Red release knob for proper damper function check




## Actuator Operated Activation Mechanism

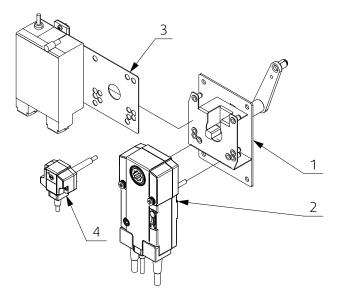

#### Legend

1	Mechanism base
2	Belimo actuator (different type according to compatibility code)
3	Base with communication unit (standardly BKN230-24) (included only in BST0)
4	Electro-thermal fuse fuse (standard BAE, 72°C)

Fig. 2: Components of the Belimo actuator operated activation mechanism - B230T; B24T; B24T-W; BST0

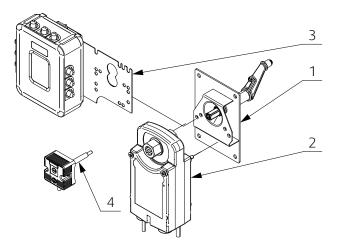

### Legend

1	Mechanism base
2	Gruner actuator (different type according compatibility code)
3	Base with communication unit (standardly fs-UFC24-2) (included only in GST0)
4	Electro-thermal fuse (standard TAE, 72°C)

Fig. 3: Components of the Gruner actuator operated activation mechanism - G230T; G24T; G24T-W; GST0

# Dimensions

Manually Operated Activation Mechanism

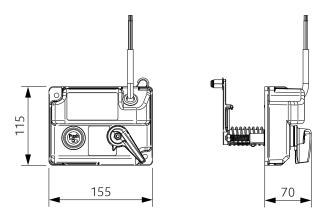


Fig. 4: Dimensions of the manually operated activation mechanism

## Actuator Operated Activation Mechanism

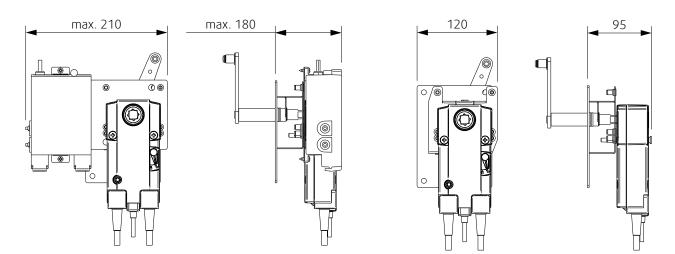





Fig. 5: Dimensions of the Belimo actuator mechanism with (left) and without (right) communication unit










Fig. 6: Dimensions of the Gruner actuator mechanism with (left) and without (right) communication unit

## **Ordering Code** AM-FD-H0; H2 up to G24T-W Type of activation S44 up to J94; 3R1 up to 3SF

NOTE: \* Choose the compatibility code for your activation type and fire damper size (Tab. 2 ... Tab. 7)

### Example of the Ordering Code

AM-FD-H5-2-S44

Compatibility code \*

Activation mechanism, manually operated with a 24 V AC electromagnetic release in impulse connection (release takes place when the electromagnet is activated) plus end switches, indicating the damper's closed and open position. Suitable for FDS-3G sizes from 100 × 100 up to 800 × 180 mm and FDR-3G sizes from 100 up to 225 mm.



## Check your code

Use AM-FD Selector on ♂ Systemair DESIGN for ordering.

## **Compatibility Codes**

The compatibility code describes the strength as well as the differences between mechanism construction. To complete the ordering code, choose the compatibility code for your activation type and fire damper size in the following tables.

### IMPORTANT:


Make sure you look for the compatibility code in the desired mechanism type table.

Tab. 2: Compatibility code for the FDR-3G circular fire damper with all activation types

	FDR-3G							•				DI	N (mm	ı)												
	FUR-3G	100	125	140	150	160	180	200	225	250	280	315	355	400	450	500	560	630	710	800	850	900	950	1000		
	H0 H2 H5-2 H6-2				SZ	14						S94				BS	94		J94							
	B230T B24T				31	.1					3L2 3N2									3	F4					
Activation Types	DV7-T-W B24T-W DV7-T-ST BSTO	351 352									353				35	δN			3SF							
	G230T G24T	3L1									3L2		3N5				31	٧X	3F4							
	G7-T-W G24T-W G7-T-ST GST0	351 352								353		355 35X						3SF								




Tab. 3: (part 1/2) Compatibility code for the FDS-3G rectangular fire damper, manually operated activation mechanisms

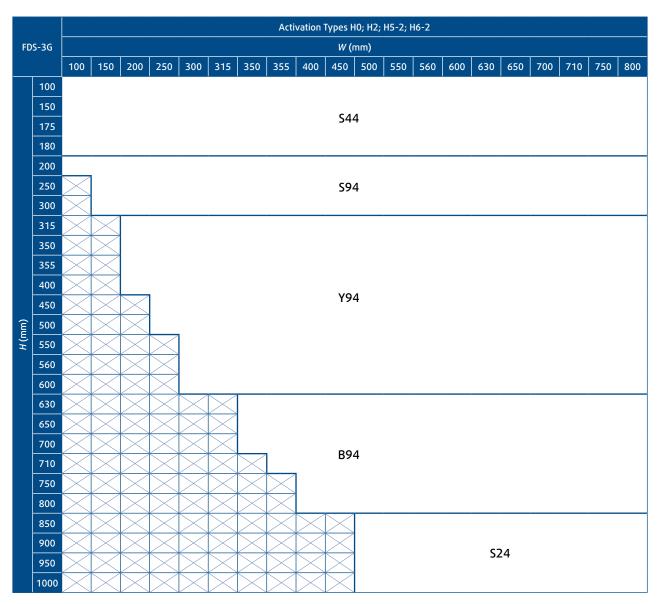

				•			ļ	Activati	on Typ	es H0; I	H2; H5-	-2; H6-	2			•		
FD	S-3G									W (mm	)							
		850	900	950	1000	1050	1100	1120	1150	1200	1250	1300	1350	1400	1450	1500	1550	1600
	100										$\geq$			$\geq$	$\geq$	$\geq$	$\geq$	$\ge$
	150					Y44					$\geq$					$\geq$		$\geq$
	175					144					$\geq$		$\geq$	$\geq$	$\geq$	$\geq$	$\geq$	$\geq$
	180										$\ge$		$\geq$	$\mid$		$\times$	$\mid$	$\geq$
	200																$\geq$	$\bowtie$
	250					Y94											$\bowtie$	$\bowtie$
	300																$\bowtie$	$\bowtie$
	315												B	24			$\bowtie$	$\bowtie$
	350																$\bowtie$	$\bowtie$
	355																$\ge$	
	400																	
	450																	
(mm) <i>H</i>	500																	
Н	550					B94												
	560																	
	600 630																	
	650																	
	700																	
	710												S	24				
	750																	
	800																	
	850		1								I							
	900																	
	950																	
	1000																	


Tab. 3: (part 2/2) Compatibility code for the FDS-3G rectangular fire damper, manually operated activation mechanisms

Tab. 4: (part 1/2) Compatibility code for the FDS-3G rectangular fire damper with Belimo actuator operated activation mechanisms

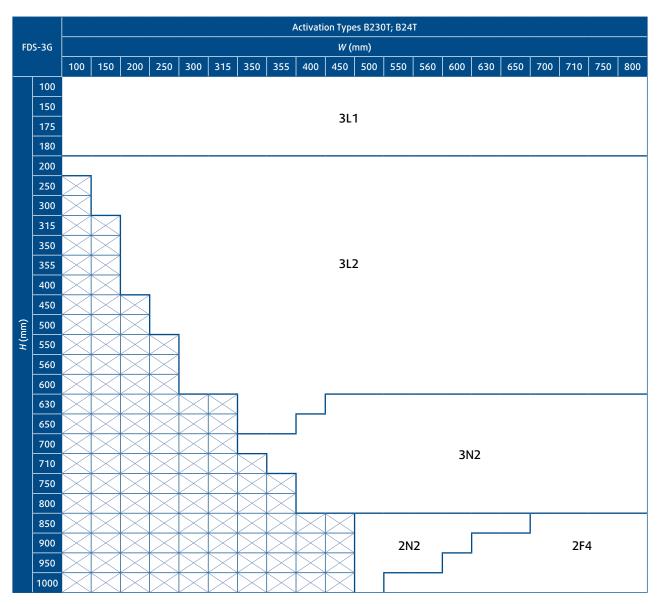

Tab. 4: (part 2/2) Compatibility code for the FDS-3G rectangular fire damper with Belimo actuator operated activation mechanisms


Tab. 5: (part 1/2) Compatibility code for the FDS-3G rectangular fire damper with Belimo actuator operated activation mechanisms plus preparation for communication unit or plus the communication unit itself

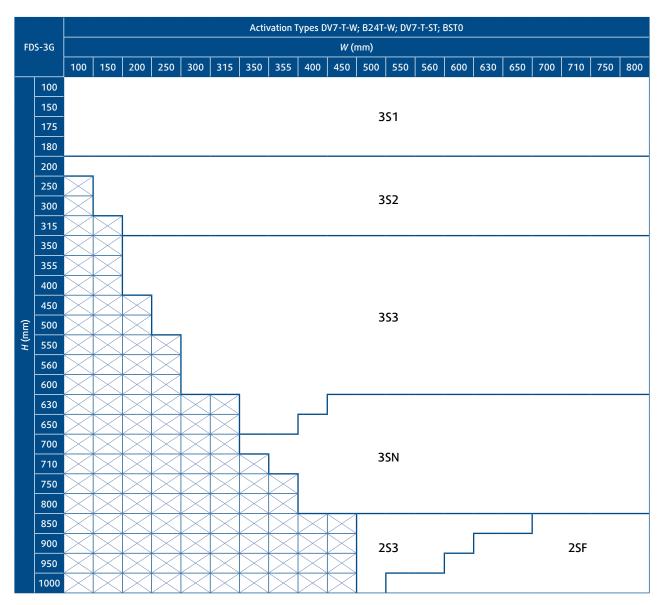

Tab. 5: (part 2/2) Compatibility code for the FDS-3G rectangular fire damper with Belimo actuator operated activation mechanisms plus preparation for communication unit or plus the communication unit itself


						A	ctivatio	on Type	T-W; B2	324T-W; DV7-T-ST; BST0												
FD	S-3G									W (mm)	)											
		850	900	950	1000	1050	1100	1120	1150	1200	1250	1300	1350	1400	1450	1500	1550	1600				
	100										$\ge$	$\triangleright$	$\ge$	$\triangleright$	$\triangleright$	$\ge$	$\ge$	$\searrow$				
	150					3S1					$\ge$	$\geq$	$\ge$	$\triangleright$	$\geq$	$\geq$	$\ge$	$\ge$				
	175					551					$\geq$	$\geq$	$\geq$		$\geq$	$\geq$	$\ge$	$\ge$				
	180										$\geq$	$\geq$	$\geq$	$\triangleright$	$\geq$	$\ge$	$\geq$	$\geq$				
	200															$\ge$	$\geq$					
	250					262						20					$\ge$	$\geq$				
	300					352					25	L				$\geq$	$\ge$					
	315																$\ge$	$\ge$				
	350																$\ge$	$\ge$				
	355					353					252											
	400																					
	450																					
(mm) <i>H</i>	500											25										
н (	550																					
	560																					
	600																					
	630																					
	650					3SN								2	SF							
	700																					
	710																					
	750																					
	800																					
	850																					
	900																					
	950																					
	1000																					

Tab. 6: (part 1/2) Compatibility code for the FDS-3G rectangular fire damper with Gruner actuator operated activation mechanisms

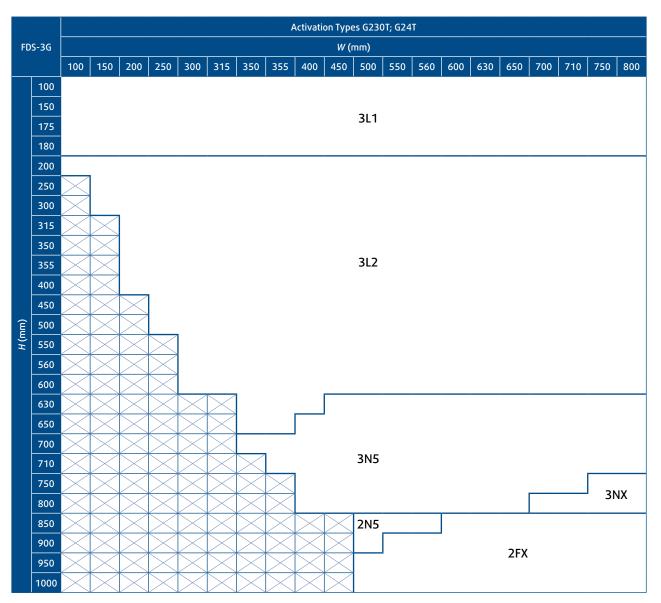

Tab. 6: (part 2/2) Compatibility code for the FDS-3G rectangular fire damper with Gruner actuator operated activation mechanisms

Tab. 7: (part 1/2) Compatibility code for the FDS-3G rectangular fire damper with Gruner actuator operated activation mechanisms plus preparation for communication unit or plus the communication unit itself

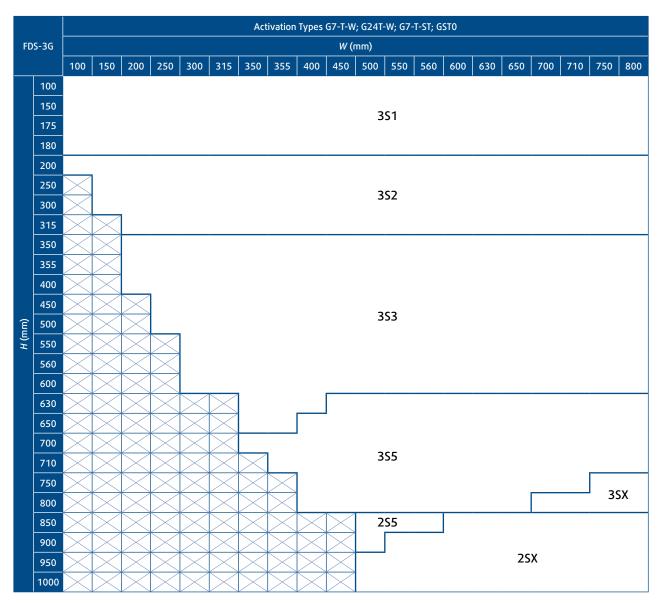

Tab. 7: (part 2/2) Compatibility code for the FDS-3G rectangular fire damper with Gruner actuator operated activation mechanisms plus preparation for communication unit or plus the communication unit itself

							Activat	tion Typ	T-W; G2	24T-W;	G7-T-S	T; GSTO									
FD	S-3G									W (mm)	)										
		850	900	950	1000	1050	1100	1120	1150	1200	1250	1300	1350	1400	1450	1500	1550	1600			
	100										$\ge$	$\triangleright$	$\triangleright$	$\triangleright$	$\ge$	$\triangleright$	$\geq$	$\searrow$			
	150					351						$\triangleright$	$\triangleright$	$\triangleright$	$\geq$	$\triangleright$	$\geq$	$\ge$			
	175					221								$\geq$	$\geq$	$\geq$	$\geq$	$\ge$			
	180										$\ge$	$\geq$	$\geq$	$\geq$	$\ge$	$\geq$	$\ge$	$\ge$			
	200																$\geq$	$\geq$			
	250					352						25					$\geq$	$\ge$			
	300					332						23	L				$\geq$	$\ge$			
	315																$\geq$	$\geq$			
	350																$\geq$	$\geq$			
	355					353									<b>~</b> ~		$\ge$	$\ge$			
	400													252							
	450											25	-								
(mm) <i>H</i>	500											25	5								
H (r	550					3S5															
	560																				
	600																				
	630																				
	650																				
	700					3SX					2SX										
	710					222					237										
	750																				
	800																				
	850																				
	900																				
	950																				
	1000														-						

## **Technical Parameters**

Durability Test	50 cycles/manually operated activation mechanism - with no change of the required properties
	10000 + 100 + 100 cycles/actuator operated activation mechanism – with no change of the required properties
	Manually operated: 74°C as standard (100°C upon request) by means of a spring after the melting of the thermofuse
Activation Temperature	Actuator operated: 72°C as standard (95°C or 120°C upon request) by means of a spring after current interruption in the electro-thermal fuse
Ambient Temperature	Maximum of 60°C for 72°C/74°C thermofuse, maximum 85°C for 100°C thermofuse, maximum 105°C for 120°C thermofuse
Repeated Opening	It is possible to open the device in cold conditions
Closing Time	Manually operated < 10 s, actuator operated < 20 s
Indicator	Manually operated 230 V microswitches - versions H2 up to H6-2
Closed/Open	Actuator operated built-in microswitches - version B230T/G230T up to B24T-W/G24T-W
Environment Suitability	Only indoor environment (3K5 according to EN 60721-3-3)
Inspection Possibility	After removing the activation mechanism, or by opening the inspection lid
Maintenance	Not required/cleaning with a dry cloth if demanded by law in the country in which the fire dampers are installed
	2006/42/ES Machinery Directive
Conformity with EC Directives	2006/95/ES Low Voltage Directive
	2004/108/ES Electromagnetic Compatibility Directive



♂ Systemair DESIGN

## Installation, Maintenance and Operation

Information about installation, maintenance and operation is available in the document "UserManual\_AM-FD" on  $\mathscr{O}$  Systemair DESIGN.

## Transport & Storage

Dry indoor conditions with a temperature range of -20°C to +50°C.

## Supplement

Any deviations from the technical specifications contained herein and the terms should be discussed with the manufacturer. We reserve the right to make any changes to the product without prior notice, provided that these changes do not affect the quality of the product and the required parameters.

Current information on all products is available on  $\mathscr{O}$  Systemair DESIGN.




# **Related Products**

## FDR-3G, FDS-3G, FDS-EI90S and FDS-EI120S

## Fire Dampers

Product information is available within the "DataSheet\_FDR\_FDS" technical documentation on  $\mathscr{O}$  Systemair DESIGN.



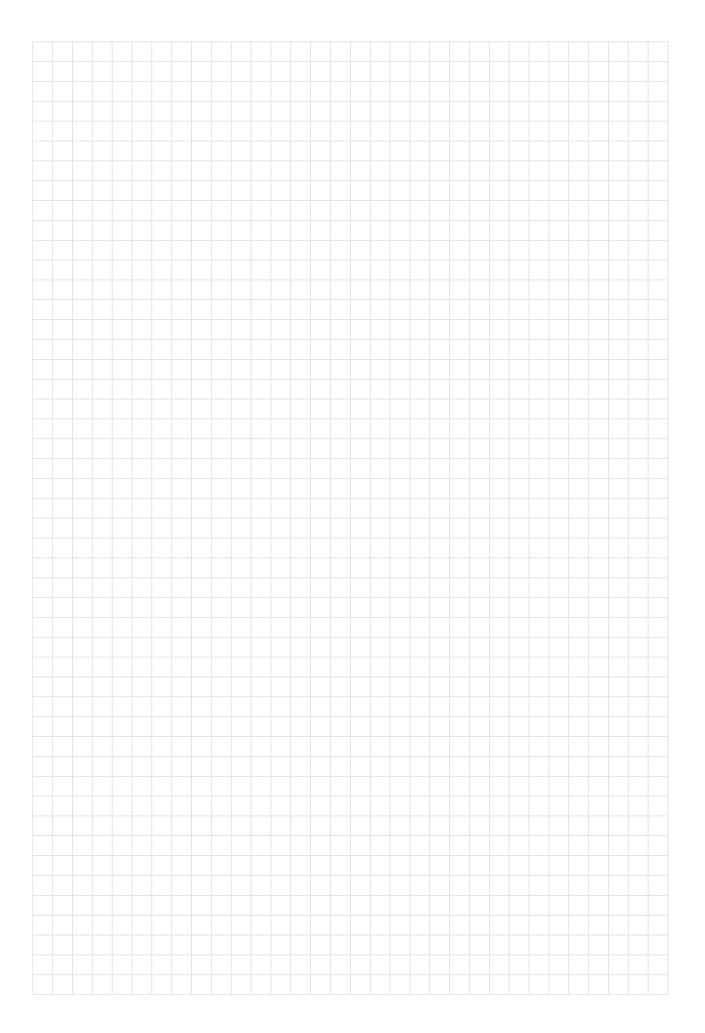



www.systemair.com