


Electrical connection fan with electronic delay relay NLE

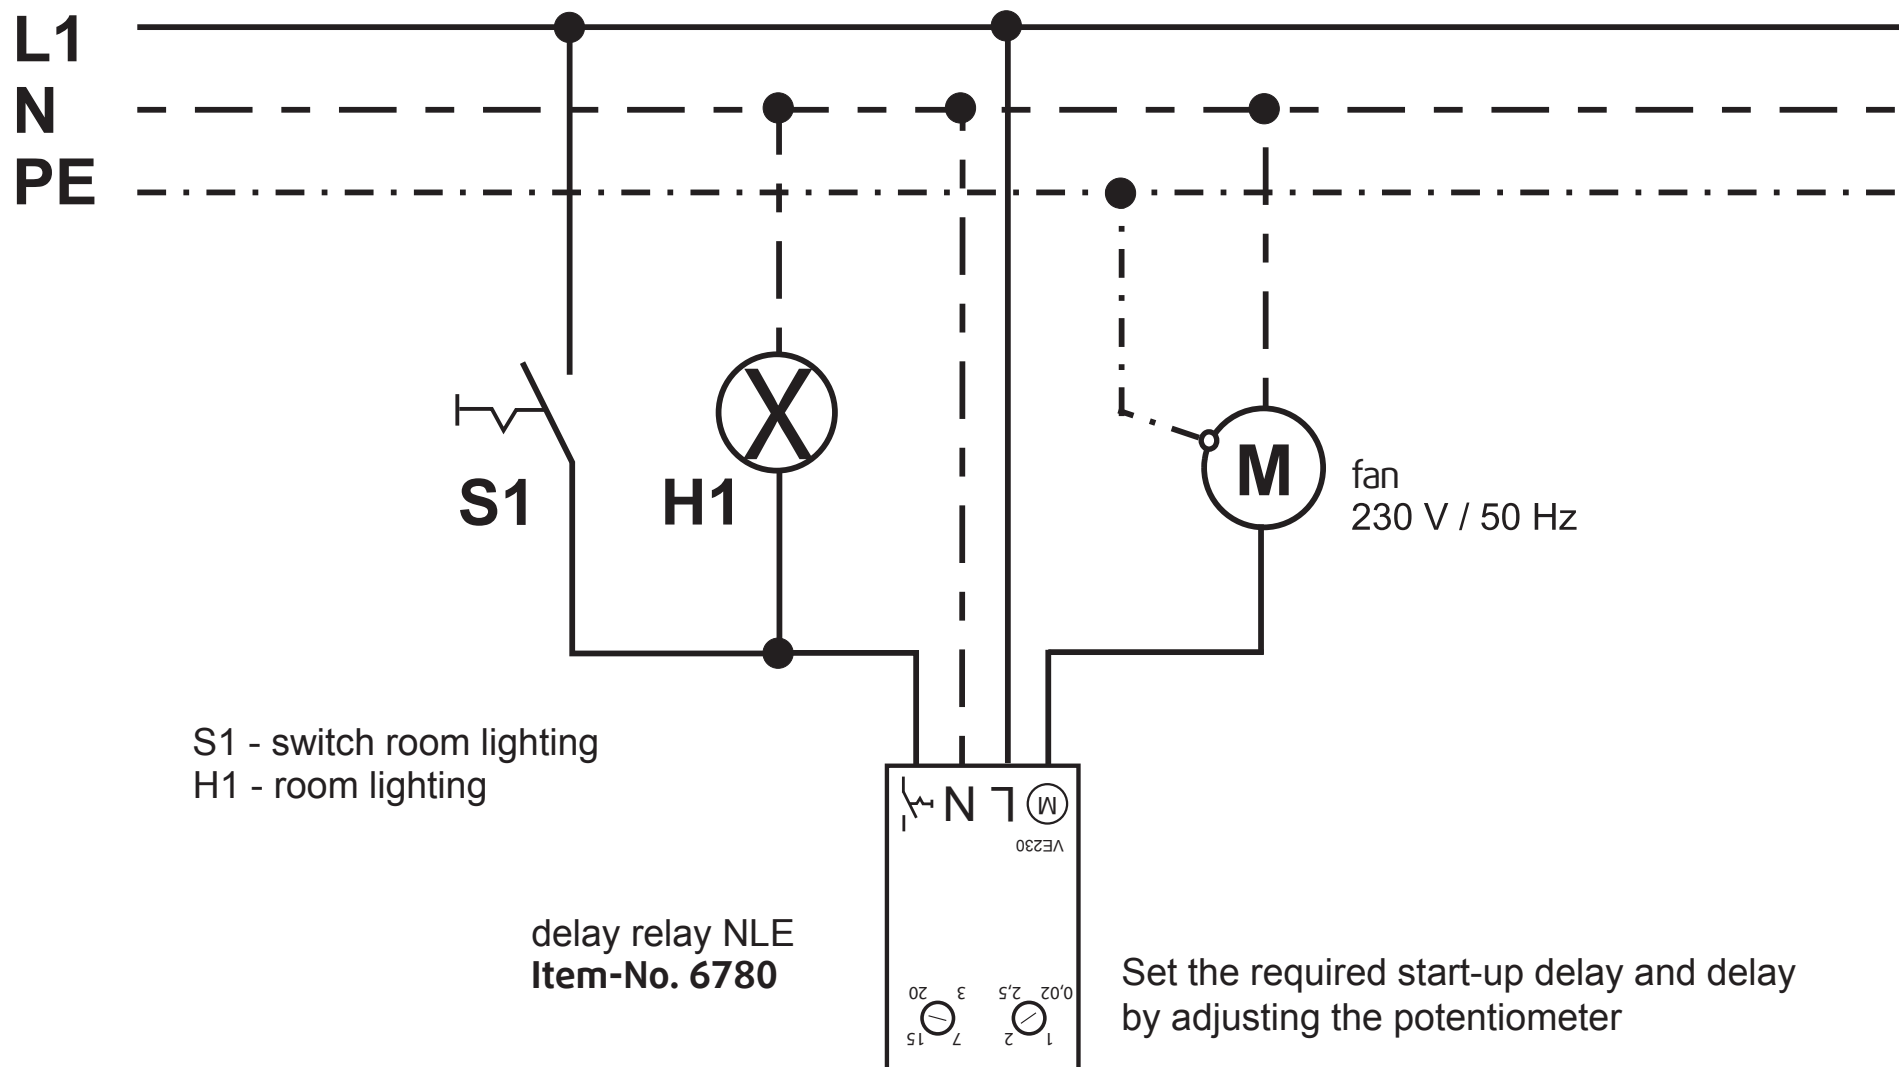

The electrical connection must be performed by a specialist according to VDE 0100. During installation and assembly work an all-pole disconnection must be made from the mains with a minimum 3 mm contact opening width.